


**BATMAN-3** Monitoring of humidity discriminators, US water detectors, broken water sensor cables, and power in rack 5  
Designed by Alexandre (Sasha) Telnov (atelnov@lbl.gov)

Lawrence Berkeley National Laboratory, 1998

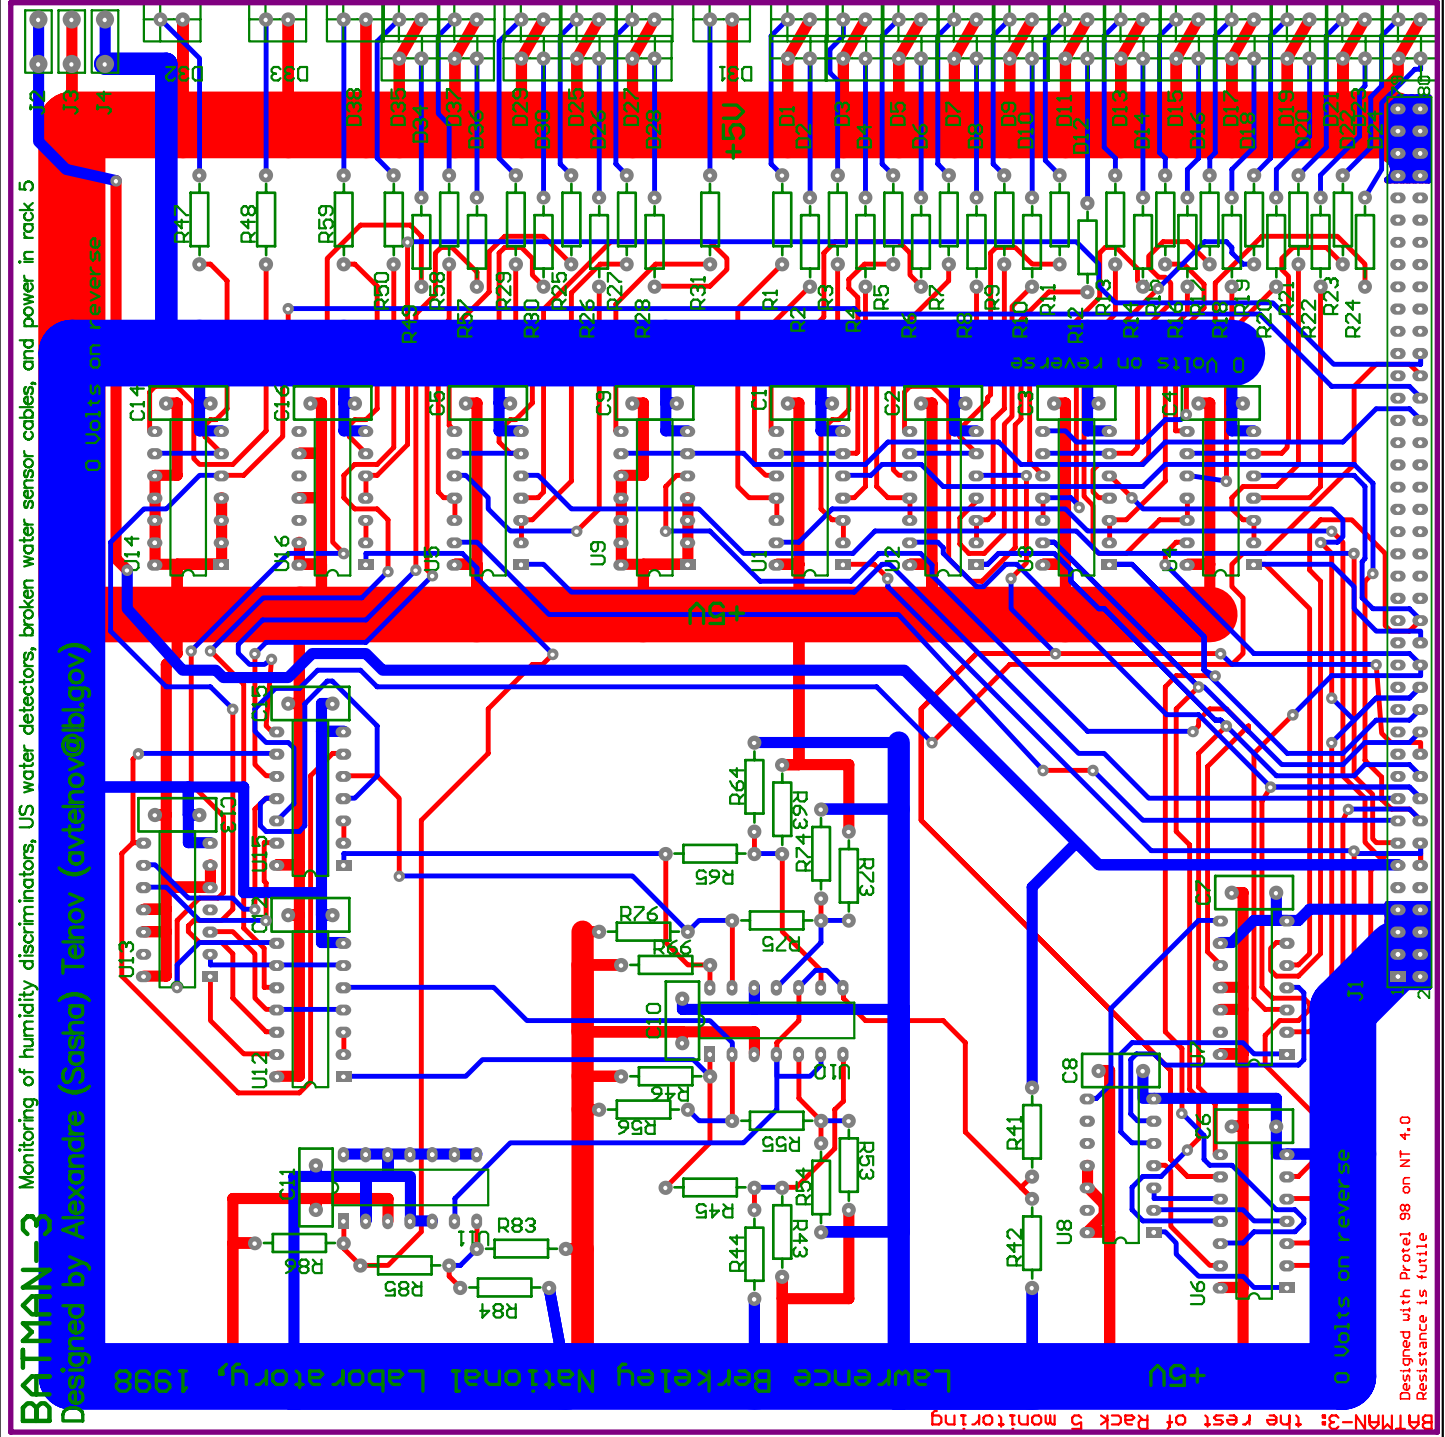

BATMAN-3: the rest of Rack 5 monitoring

Designed with Protel 98 on NT 4.0  
Resistance is futile

6500 (mil)

6500 (mil)