Region 8-A PR08

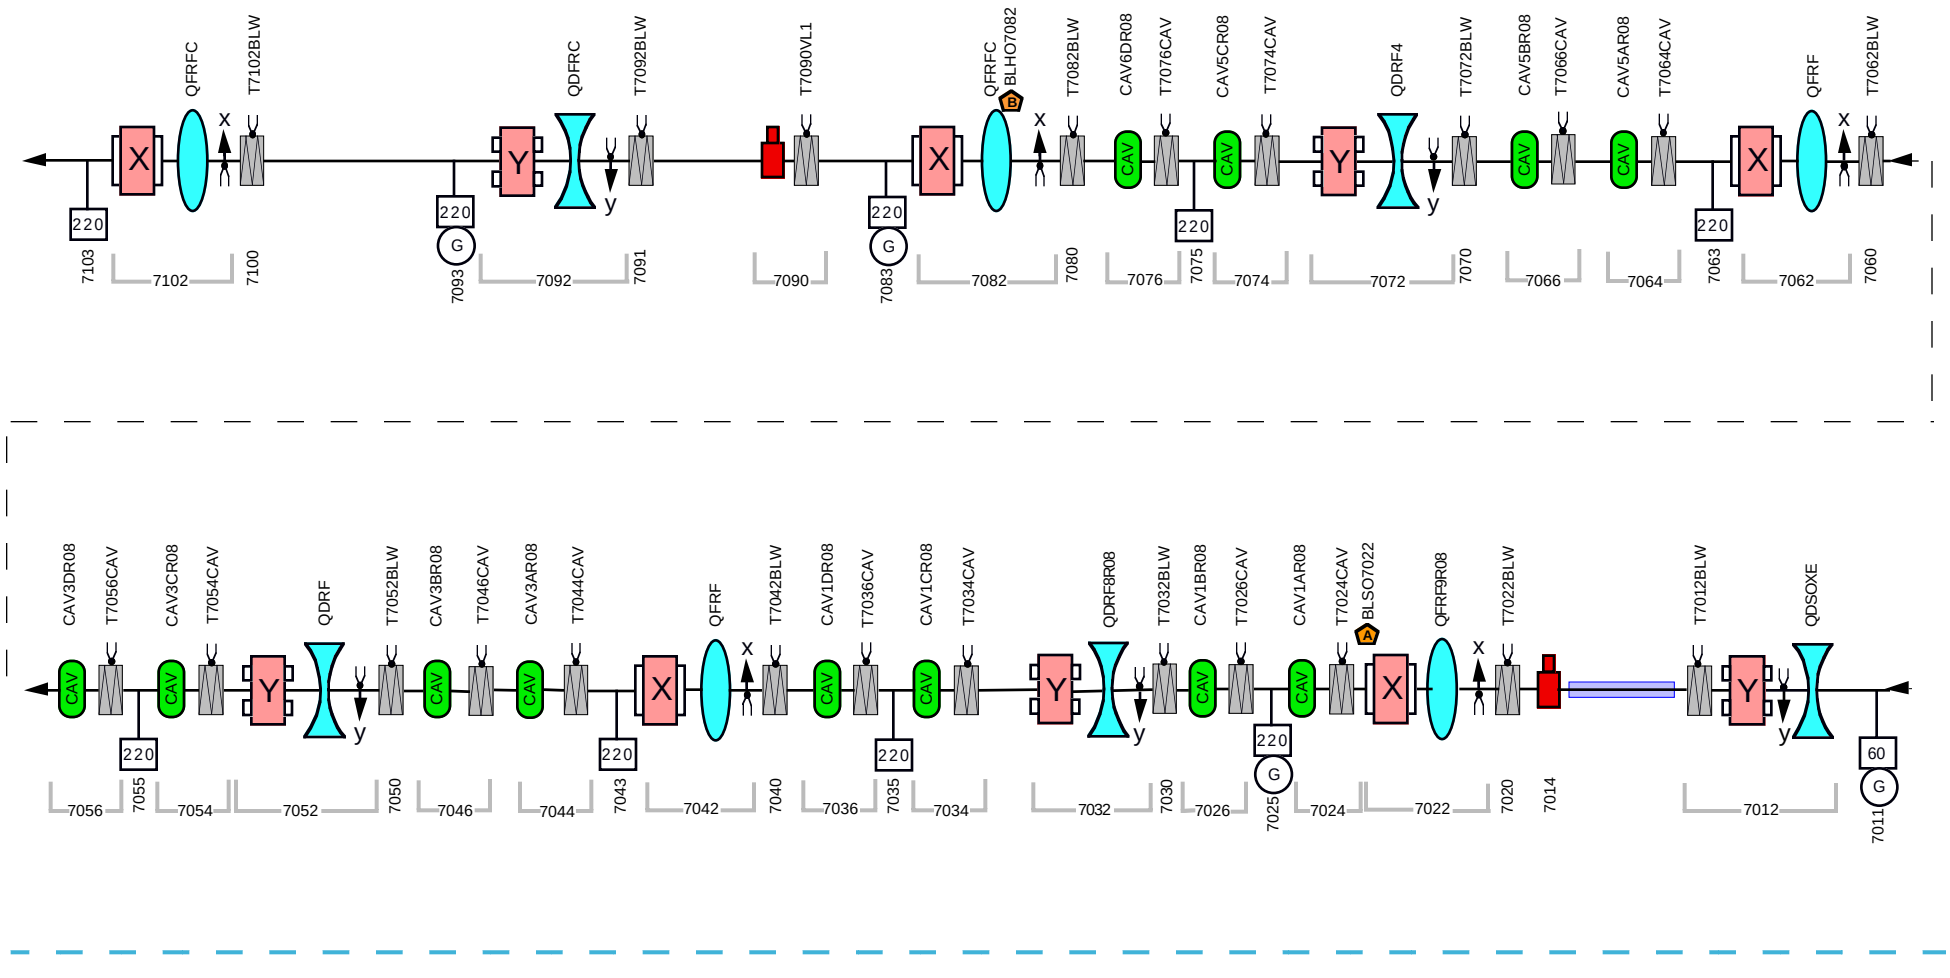

Focusing quad

Defocusing quad

Horizontal corrector

Vertical corrector

RF Cavity

Vacuum Valve

NEG pump

Horizontal BPM

Vertical BPM

Beam Loss Monitor
A-above
B-below
the beam line

Bellows

Ion pump (XX0 l/sec)

Vacuum gauge

Thermocouple